


Ensure the meter manufacturer's installation recommendations are followed for the unobstructed straight length of pipeline required upstream and downstream of the meter

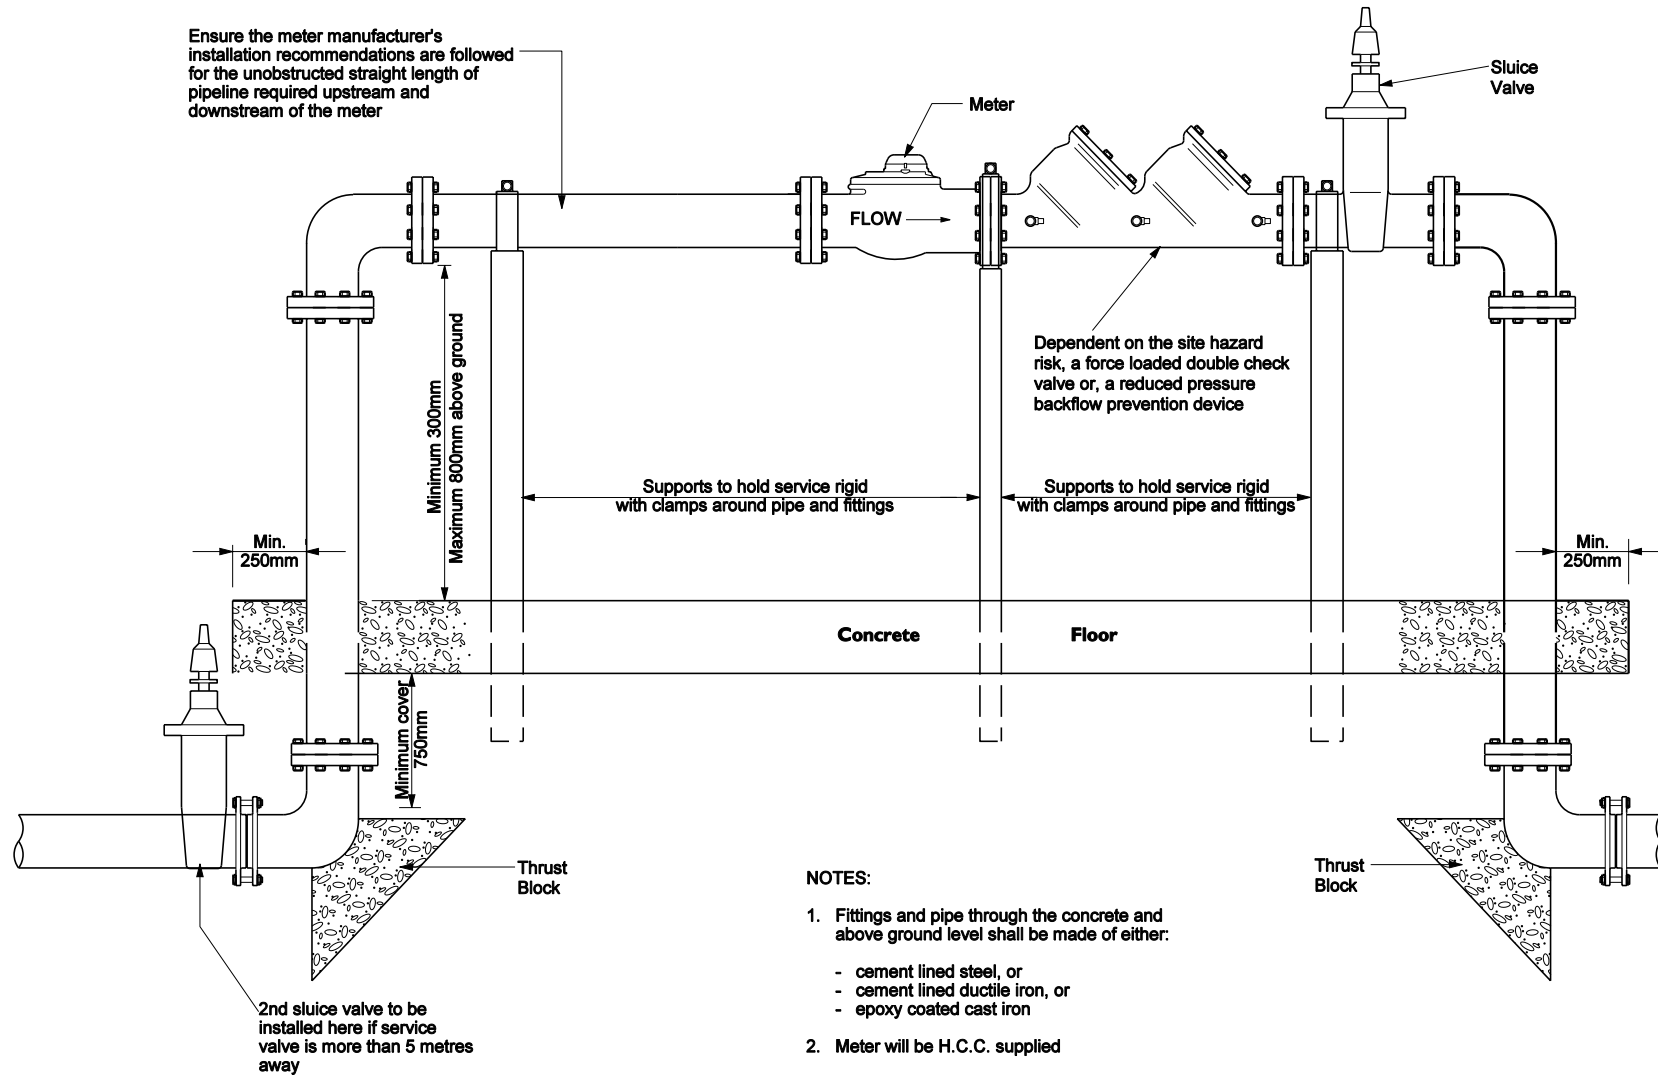

NOTES:

1. Fittings and pipe through the concrete and above ground level shall be made of either:
 - cement lined steel, or
 - cement lined ductile iron, or
 - epoxy coated cast iron
2. Meter will be H.C.C. supplied
3. Supports to be minimum 100x100 H4 posts or 100 Ø galvanised pipe
4. Clamps to be galvanised
5. Service to be tested to 1400 KPA to 1st joint above ground

Not To Scale